# 2512 75 Watt AC/DC Power Supply





# Description

The 2512 is a 120/240VAC/125VDC Power Supply designed for CTI 2500 Series and SIMATIC® 505® PLCs. The triple-wide module provides up to 75 watts at +5VDC for use by the PLC CPU and I/O modules.

The 2512 also provides power using 125VDC from battery backup systems like those found in utility applications.

## **Features**

ocess Control System

- CTI 2500 Series® or Simatic® 505 base format
- 90-264VAC, 47-63 Hz single-phase input power
- 125 VDC input power for utility applications
- Up to 75 watts @ +5VDC to PLC CPU and I/O modules

**Special Note:** The 2512 power supply is not compatible for operation in redundant bases. Applications requiring power supply redundancy should employ the 2512-A power supply.

# **Specifications**

Field Connections: One 3-pin 120/240VAC/125VDC input terminal strip

Input Voltage Operating Range: 90-264VAC, 47-63Hz, single phase or 90-146VDC

# **Total Wattage Rating:**

75 Watts maximum output @ 0° C to 50° C (derating 1.75W/° C above 50° C)

### Steady State Input Current at full load:

1.50 Amps max. @ 110VAC 0.75 Amps max. @ 220VAC

1.27 Amps max. @ 90VDC 0.85 Amps max. @ 125VDC

Peak Inrush Current: 37 Amp. max. @ 240VAC input

**Fusing:** 1.5 Amp 250V, 3 AG front panel accessible

Hold Up Time: 100mSec @ 75W load

### **Isolation:**

1500VAC: 110/220 VAC-to-Backplane 500VDC: Chassis-to-Backplane 1500VAC: 110/220 VAC-to-Chassis IEC 60950-1

Module Size: Triple-wide

## Operating Temperature:

0° to 60° C (normal locations) 0° to 50° C (Class 1 Div 2 locations)

Storage Temperature: -40° to 85° C (-40° to 185° F)

**Relative Humidity:** 5% to 95% (non-condensing)

Agency Approvals: UL, UL-Canada, Class 1 Div 2, CE (Note: Approvals apply for VAC ranges only.)

Shipping Weight: 5.0 lbs (2.3 kg)




Control Technology Inc. 5734 Middlebrook Pike, Knoxville, TN 37921-5962 Phone: +1 865 584 0440 Fax: +1 865 584 5720

Phone: +1.865.584.0440 Fax: +1.865.584.5720 www.controltechnology.com

# 2512 75 Watt AC/DC Power Supply

#### **Power Supply Location in Base**

The Power Supply must always be installed in the left-most slot of the system base. See figure

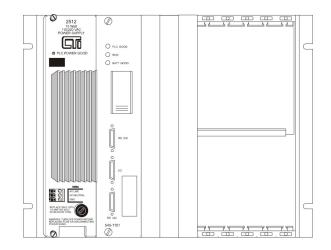



#### WARNING:

**System** 

Disable all power to the base before installing or removing the power supply. Failure to do so could cause damage to the equipment or injury to personnel.

#### CAUTION:

Do not attempt to operate the 2512 Power Supply out of the Input Voltage Operating Ranges of 90 to 264 VAC. Damage to the Power Supply could occur if out-of-range input is applied.

### Installing and Removing the Power Supply

Use the following steps for installing and removing the 2512 Power Supply from the system base.

- 1. Position the power supply so that the bezel is facing you.
- 2. Grasp the top and bottom of the power supply.
- 3. Carefully slide the power supply into the left-most slot in the base until it engages into the backplane connectors.
- 4. Tighten top and bottom bezel screws into the base chassis.

### To remove power supply, reverse procedures 1 through 4 used for installation.

Copyright© 2019 Control Technology Inc.

All Rights Reserved

22 AUG 2019

ROCK SOLID PERFORMANCE. TIMELESS COMPATIBILITY.